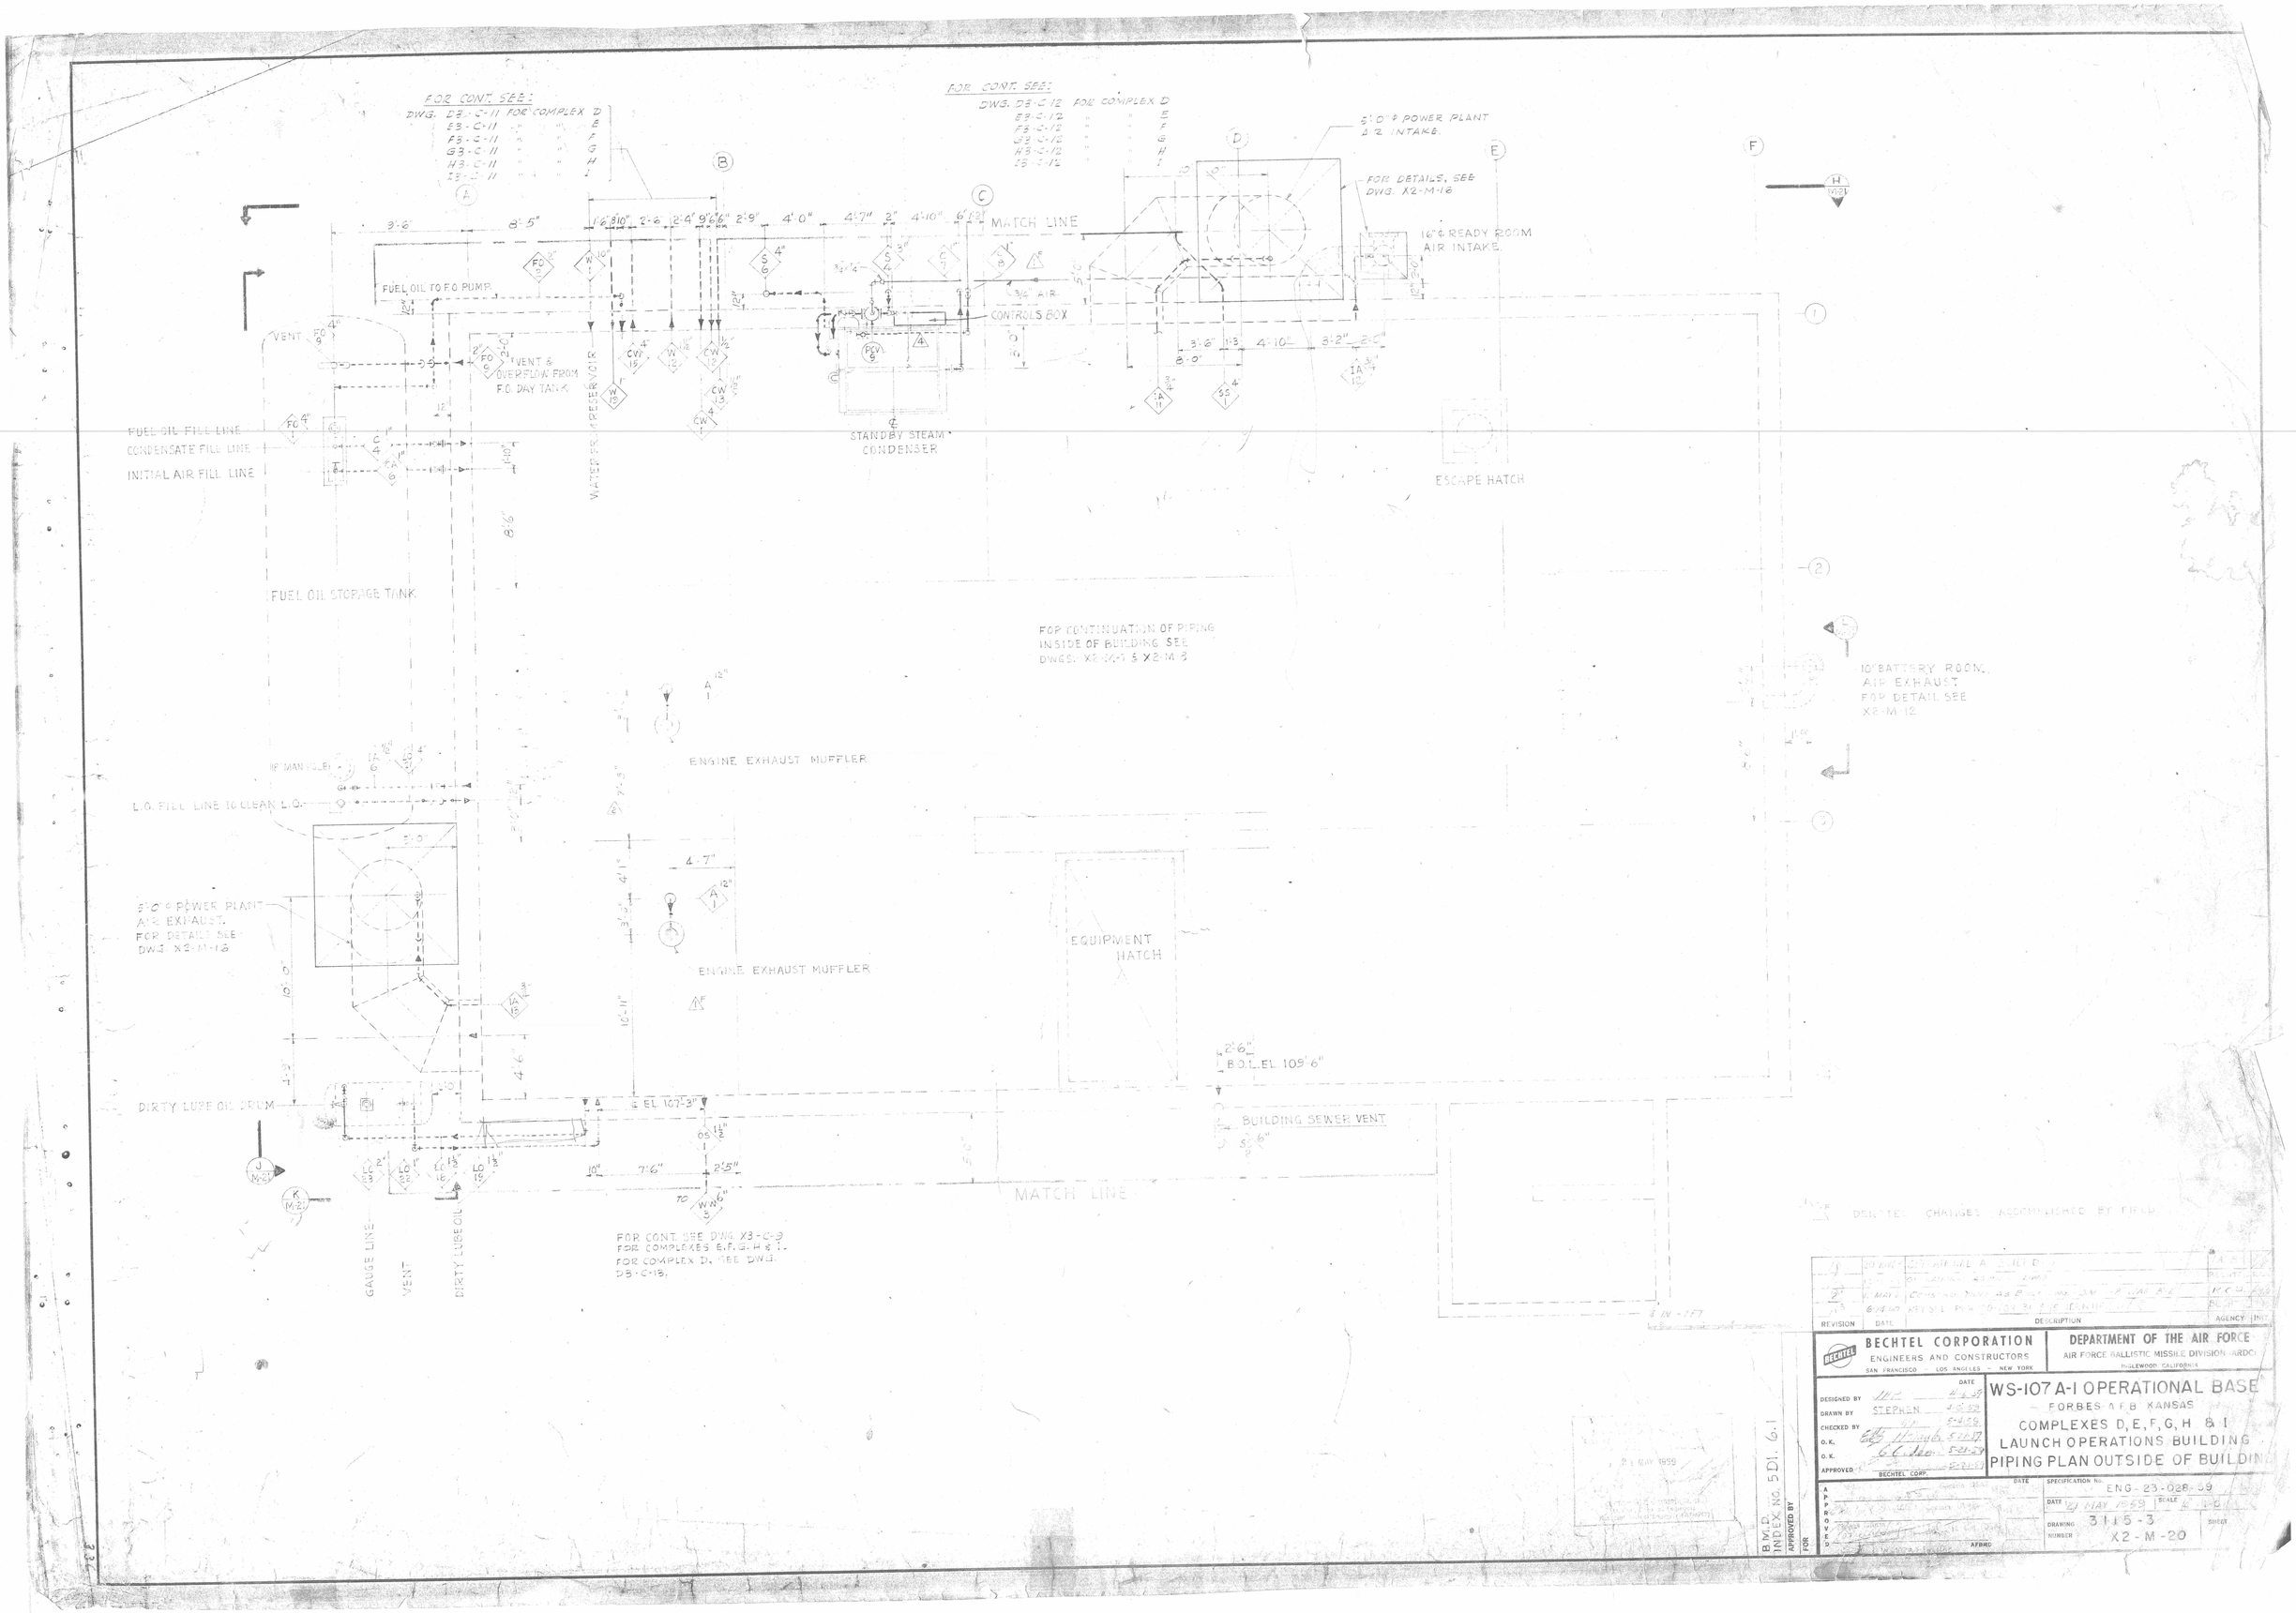
FOR CONT. SEE:
DWG. D3-C-11 FOR COMPLEX D
E3-C-11 " " E
F3-C-11 " " F
G3-C-11 " " G
H3-C-11 " " H
I3-C-11 " " I
FOR CONT. SEE:
DWG. D3-C-12 FOR COMPLEX D
E3-C-12 " " E
F3-C-12 " " F
G3-C-12 " " G
H3-C-12 " " H
I3-C-12 " " I
5'-0" ϕ POWER PLANT AIR INTAKE.
FOR DETAILS, SEE DWG. X2-M-16
16" ϕ READY ROOM AIR INTAKE.
MATCH LINE
FUEL OIL TO F.O. PUMP.
VENT
VENT & OVERFLOW FROM F.O. DAY TANK
WATER FROM RESERVOIR
3/4" AIR
CONTROLS BOX
STANDBY STEAM CONDENSER
ESCAPE HATCH
FUEL OIL FILL LINE
CONDENSATE FILL LINE
INITIAL AIR FILL LINE
FUEL OIL STORAGE TANK
FOR CONTINUATION OF PIPING INSIDE OF BUILDING SEE DWGS. X2-M-7 & X2-M-8
10" BATTERY ROOM AIR EXHAUST FOR DETAIL SEE X2-M-12
ENGINE EXHAUST MUFFLER
18" MAN HOLE
L.O. FILL LINE TO CLEAN L.O.
5'-0" ϕ POWER PLANT AIR EXHAUST. FOR DETAIL SEE DWG. X2-M-16
EQUIPMENT HATCH
B.O.L. EL. 109'-6"
DIRTY LUBE OIL DRUM
E EL. 107'-3"
BUILDING SEWER VENT
MATCH LINE
GAUGE LINE
VENT
DIRTY LUBE OIL
FOR CONT. SEE DWG. X3-C-9 FOR COMPLEXES E,F,G,H & I. FOR COMPLEX D, SEE DWG. D3-C-13.
DENOTES CHANGES ACCOMPLISHED BY FIELD
REVISION | DATE | DESCRIPTION | AGENCY | INIT.
BECHTEL CORPORATION
ENGINEERS AND CONSTRUCTORS
SAN FRANCISCO LOS ANGELES NEW YORK
DEPARTMENT OF THE AIR FORCE
AIR FORCE BALLISTIC MISSILE DIVISION (ARDC)
INGLEWOOD, CALIFORNIA
DESIGNED BY
DRAWN BY STEPHEN
CHECKED BY
O.K.
O.K.
APPROVED
BECHTEL CORP.
WS-107 A-1 OPERATIONAL BASE
FORBES A.F.B. KANSAS
COMPLEXES D, E, F, G, H & I
LAUNCH OPERATIONS BUILDING
PIPING PLAN OUTSIDE OF BUILDING
SPECIFICATION No. ENG-23-028-59
DATE 21 MAY 1959
SCALE 1/8"=1'-0"
DRAWING NUMBER 3115-3
X2-M-20
SHEET
APPROVED FOR AFBMD
B.M.D. INDEX NO. 5D1.6.1
APPROVED BY
21 MAY 1959